

Operating Instruction for Compact Pressure Switch

Model: KPH

Order from: **C A Briggs Company**

622 Mary Street; Suite 101; Warminster, PA 18974

Phone: 267-673-8117 - Fax: 267-673-8118

Sales@cabriggs.com - www.cabriggs.com



KPH Series Pressure Switch Selection and Mounting Instructions

1. Select a switch such that the desired switching point falls roughly in the middle of the adjustment range.
2. Be sure that your media is fully compatible with all wetted parts.
3. Do not exceed switch electrical ratings. Use an appropriately sized relay when switching larger electrical loads.
4. When switching inductive DC loads (relays, solenoids, etc), the use of a suitable spark suppression device (such as a diode or RC network), is strongly recommended to maximize electrical contact life.
5. For liquid media with pressure spikes and/or pulsating pressures, install a pressure snubber.
6. For outdoor applications, sufficient weather protection must be provided. Critical conditions include aggressive atmosphere, salt bearing atmosphere, and drastic temperature variations.

Adjustment of Switching Point

Either the upper or the lower switching point may be adjusted. The opposite point is then fixed by the “deadband” characteristic of the switch. The switching point may be set even during operation. Use a pressure gauge for exact adjustment.

Proceed as follows:

1. Loosen locking screw using a small slotted screwdriver.
2. Adjust the switching point using a 5 mm hexagon wrench.
 - For vacuum models: Counter-clockwise rotation increases the switching point (“high” vacuum) and clockwise rotation decreases the switching point (“low” vacuum). The high-end of the adjustment range is reached when the top of the adjustment barrel screw is approximately level with top of switch housing. The low-end of the adjustment range is reached when the adjustment barrel screw has been turned fully clockwise.
 - For positive pressure models: Clockwise rotation increases switching pressure and counter-clockwise rotation decreases switching pressure. The low-end of the adjustment range is reached when the top of the adjustment barrel screw is approximately level with top of switch housing. The high-end of the adjustment range is reached when the adjustment barrel screw has been turned fully clockwise.
3. Re-tighten the locking screw.

Splash Protection Cover


A plastic cover for the pressure adjustment end of the switch is available as either a production option (suffix code:“EC”) or an accessory (item number: KPH-PEC). This cover provides splash protection to the switch adjustment mechanism and is recommended when the device is subjected to splashing liquids.

Electrical Connection

Switching function: SPDT Microswitch w/ DIN 43650A Connector

- For vacuum models:
Terminals 1 - 2: N/O below switchpoint (Contacts close with increasing vacuum)
Terminals 1 - 3: N/C below switchpoint (Contacts open with increasing vacuum)
- For positive pressure models:
Terminals 1 - 2: N/C below switchpoint (Contacts open on rising pressure)
Terminals 1 - 3: N/O below switchpoint (Contacts close on rising pressure)

Switch Dimensions

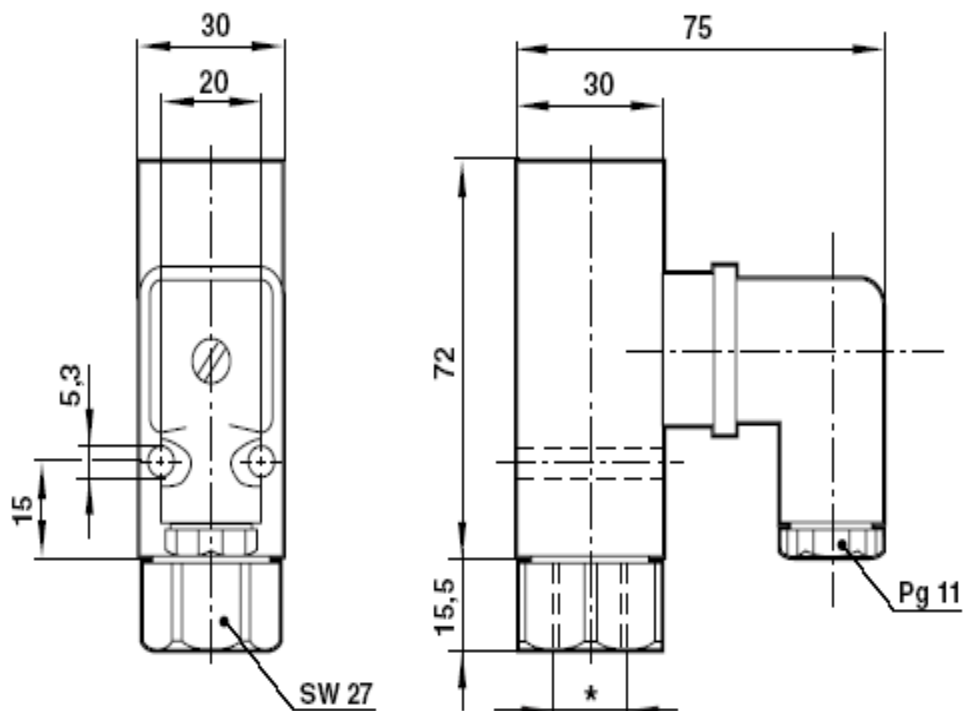

* = 1/4" FNPT or SAE # 4 (7/16-20 UNF)

Optional Splash Cover Dimensions

